

APPENDIX G

ARSENIC CONCENTRATION GRAPH

BENCHMARK LOCATIONS

Note: Because there was such minimal variation in concentration at the benchmark locations and because many of the data points were nondetectable, concentrations were not graphed for the benchmark locations.

SACRAMENTO REGIONAL WASTEWATER TREATMENT PLANT EFFLUENT

Figure G-1 Sacramento Regional Wastewater Effluent Concentration: 91 - 7/93

Notes: Concentrations range from nondetectable (which show as negative numbers on the graph) to almost 3.5 $\mu\text{g/l}$. The only apparent trend is that wet year concentrations appear higher than dry year concentrations.

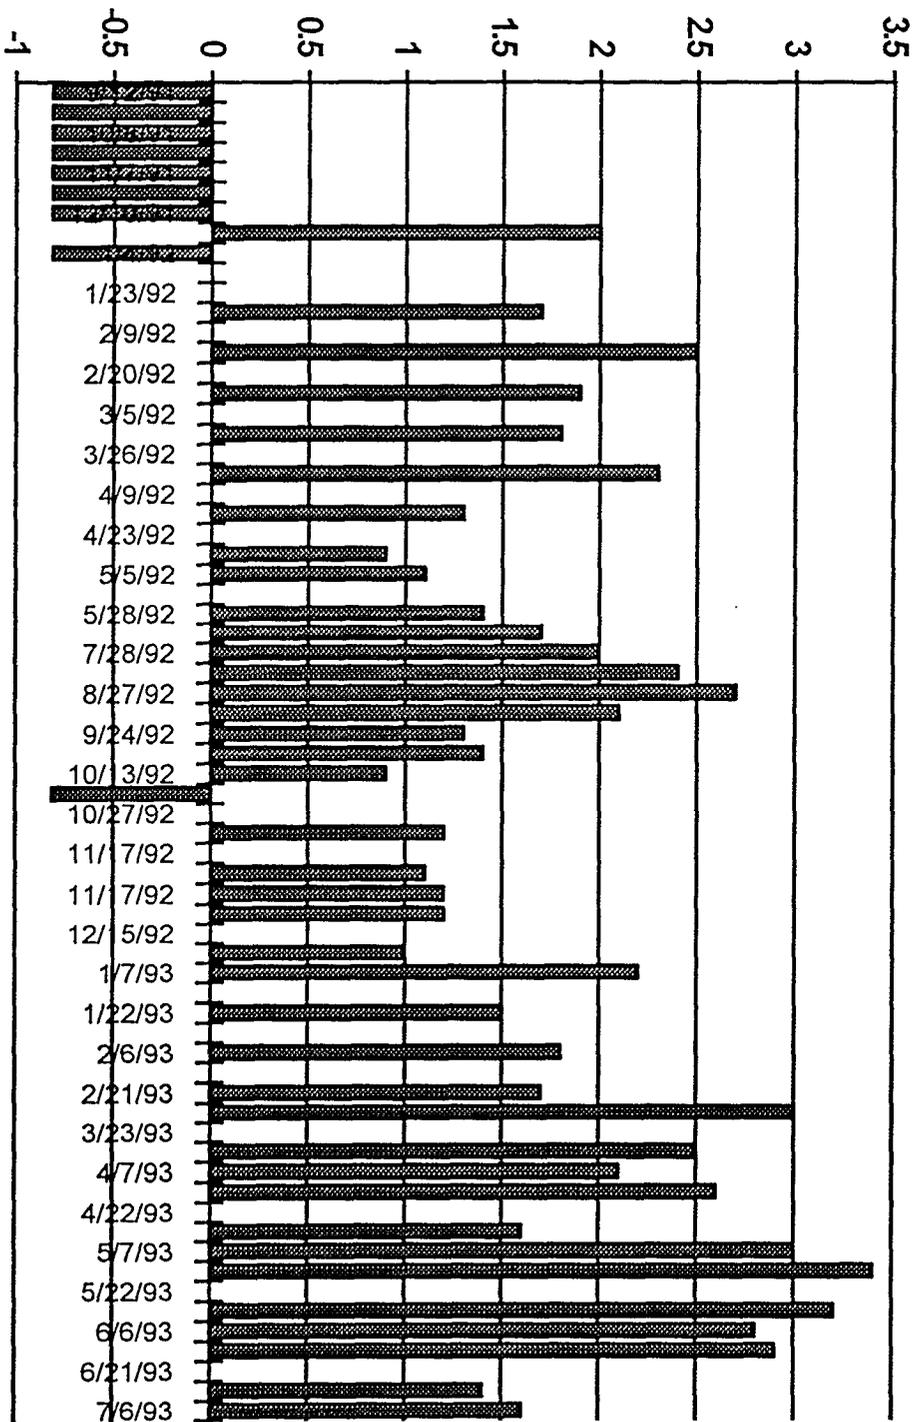


Figure G-1. Sacramento Regional Wastewater Effluent Total Arsenic Concentration, 1991-1993 (ug/l)