Predicted TDS Levels at H.O. Banks PP and O'Neill Forebay for Various Capacities of Isolated Transfer Facility

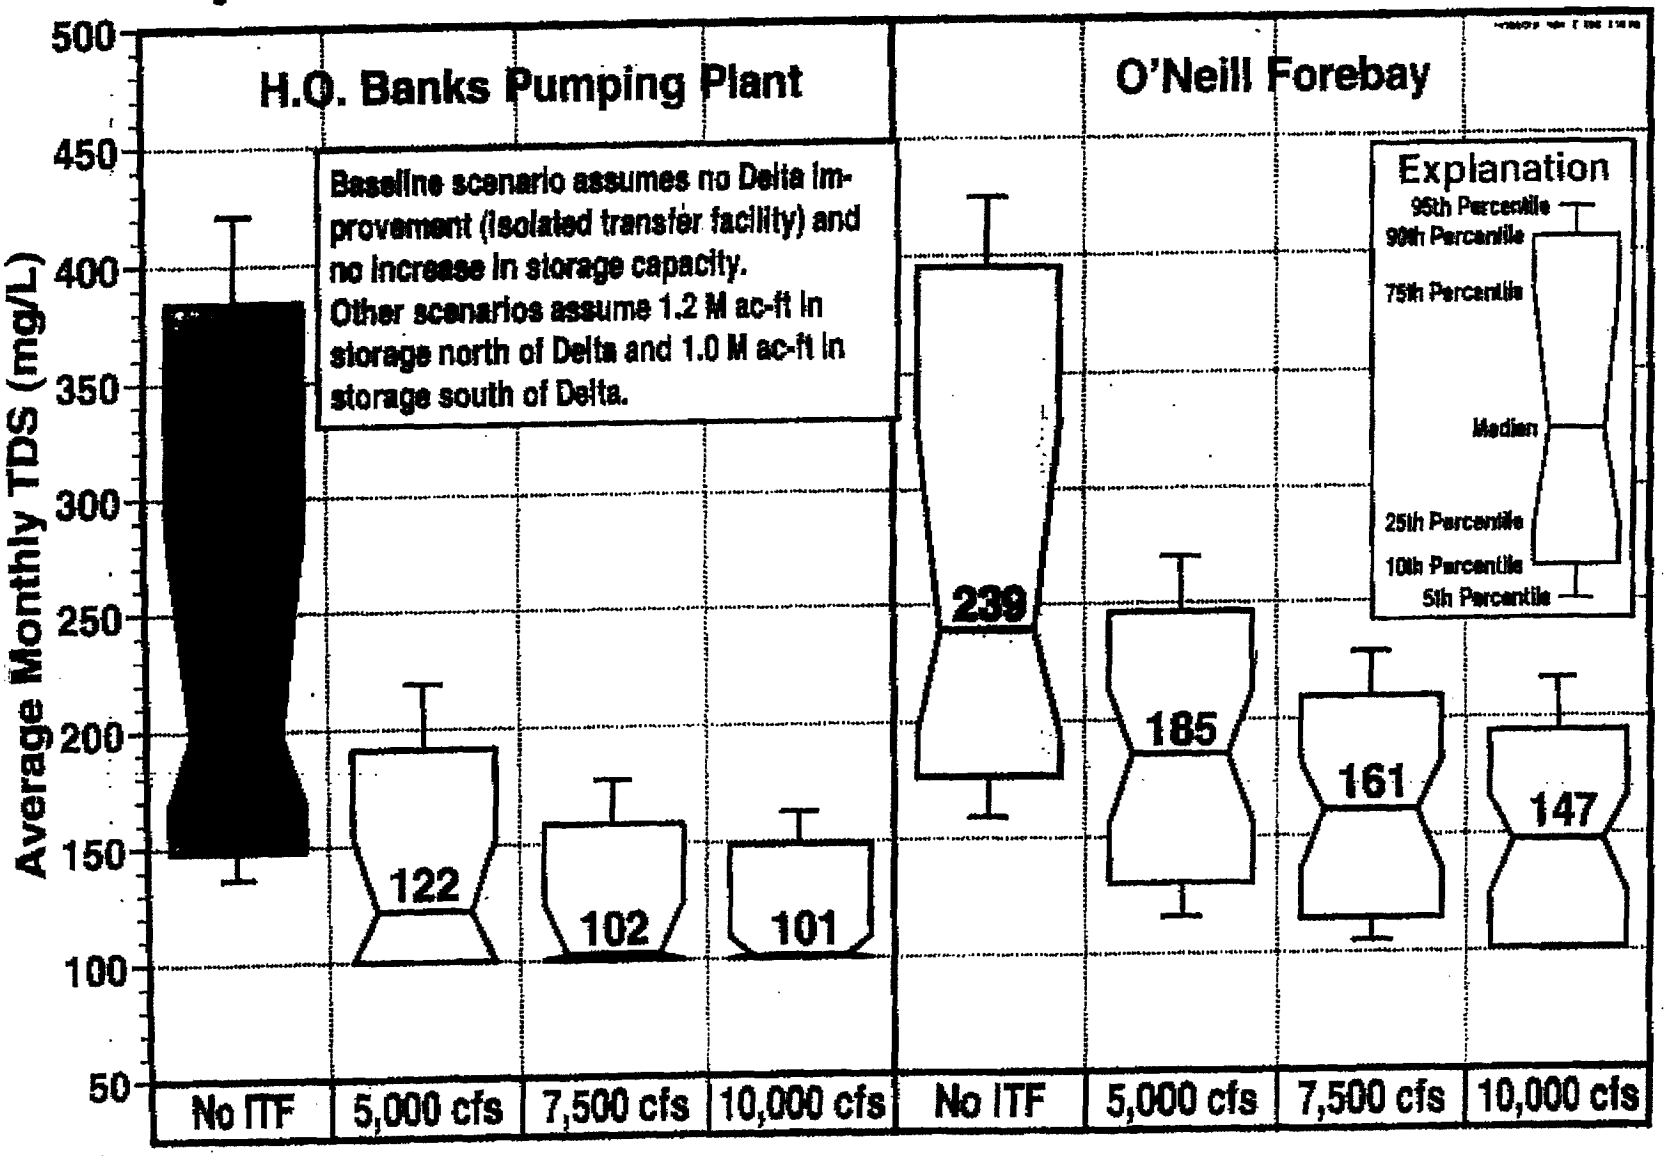

E-018767

E-018767